



City of Aberdeen
Weekly Activity Report
July 12 - 18, 2026

I. City Hall

A. Department of Finance

B. Department of Planning and Community Development (DPCD)

C. Department of Public Works (DPW)

1) City Engineering & Administration

2) Maintenance Division

3) Water/Wastewater Plant Operations

D. Human Resources Department

II. Aberdeen Police Department (APD)

A. APD Calls for Service

B. Weekly Traffic Report

C. IT

D. Accreditations

E. Administration

F. 24 Hour Reports

G. Media Release

I. City Hall
A. Department of Finance
Weekly Update

Receipts for the week were:

1. General Fund	\$ 361,377
2. Capital Projects Fund	0
3. Water & Sewer Funds	541,856
4. Stadium Fund	0
Total	<u>\$ 903,233</u>

Disbursements for the week were:

1. General Fund	\$ 595,995
2. Capital Projects Fund	14,531
3. Water & Sewer Funds	545,638
4. Stadium Fund	8,260
Total	<u>\$ 1,164,424</u>

Significant Receipts:

1. Hotel Tax	\$144,185
2. 3M PFAS Settlement	\$335,250

Significant Disbursements:

1. Payroll	\$502,356
2. Water Purchases	\$108,435
3. Filter Maintenance at WWTP	\$158,297

Procurement Activities:

1. Conducted bid opening for project 26-06, AAWTP Final Clarifier #1 Resurfacing

B. Department of Planning and Community Development (DPCD)

The following activities and actions took place this week:

1. Prepared the revisions to the draft Ordinance 26-O-06 to amend the Development Code for accessory dwelling units. The City Attorney reviewed and had minor changes which were incorporated and sent to the Planning Commission.
2. Prepared a draft Ordinance to amend Chapter 302 Growth Management to exempt accessory dwelling units from adequate public facilities requirements. The City Attorney reviewed and had minor changes which were incorporated and sent to the Mayor and City Councilmembers.
3. The MD Department of Housing and Community Development Façade Improvement Program grant application in the amount of \$100,000 to assist businesses and property owners in the downtown with interior and exterior façade improvements was submitted today.
4. Attended the City Director's and Managers meeting to provide updates on various items that each department is working on.
5. Attended Economic Development Commission meeting and provided updates on planning and zoning matters.
6. Attended meeting with Eric McLaughlin, Esquire and Tom Minor with Frederick Ward and Associate to discuss Technology Drive annexation.
7. The City Planner is working on our record retention program for our department to verify that all files are digitized and are ready for Laserfiche.

Weekly Building Permit Activities:

Permits Processed – Residential

Address	Type	Value of Construction
622 Westwood Drive	Patio	\$12,000.00
5 Roosevelt Avenue	Dumpster	\$0
320 S. Law Street	Deck	\$36,700.00
705 Everist Drive	Patio & Driveway	\$15,548.00
701 Cornerstone Lane	Sidewalk	\$5,950.00
3614 Dexter Court	Porch	\$14,000.00
3610 Dexter Court	Porch	\$8,700.00
3604 Dexter Court	Porch	\$14,000.00
3602 Dexter Court	Porch	\$11,000.00

Total: 9

\$117,898.00

Permits Processed – Commercial

Address	Type	Value of Construction
1002 Beards Hill Road	Sign	\$0
949 Beards Hill Road	Roof Alteration	\$100,000.00

Total: 2

\$100,000.00

Permits Issued this Week:

Address	Type	Value of Construction
622 Westwood Drive	Patio	\$12,000.00
1002 Beards Hill Road	Sign	\$0
210 Research Blvd.	Demo	\$14,985.00
5 Roosevelt Avenue	Dumpster	\$0
626 S. Rogers Street	Solar Panels	\$15,416.00
857 Declan Road	New Construction	\$206,000.00
855 Declan Road	New Construction	\$177,000.00
853 Declan Road	New Construction	\$181,000.00
851 Declan Road	New Construction	\$184,000.00
849 Declan Road	New Construction	\$184,000.00
847 Declan Road	New Construction	\$184,000.00
845 Declan Road	New Construction	\$184,000.00
843 Declan Road	New Construction	\$206,000.00
500 Market Street	Antenna	\$30,000.00
3614 Dexter Court	Porch	\$14,000.00
3610 Dexter Court	Porch	\$8,700.00
3604 Dexter Court	Porch	\$14,000.00
3602 Dexter Court	Porch	\$11,000.00
701 Cornerstone Lane	Sidewalk	\$5,950.00

Total: 19

\$ 1,632,051.00

Plans still under review at DILP and/or Health Department:

1255 Loflin Road – Cell tower modifications; 303 Mt Royal Avenue – Deck; 404 S. Philadelphia Blvd. – repair fire damage; 487 Roberts Way – Convert garage into living space; 218 W. Bel Air Avenue- addition/renovation; 1102 S. Philadelphia Blvd. – Tiltwall Shell Warehouse; 629 S. Philadelphia Blvd. – ALLROADS Addition; 11 Locust Lane – Interior Alteration; 12 Newton Road – New Building; 1104 S. Philadelphia Blvd. – Alteration; 783 W. Bel Air Avenue – Alteration; 48 Aberdeen Avenue – Screen Room Addition; 630 3rd Street – Carport, 36 Lewis Drive– Front porch; 110 S. Philadelphia Blvd. – Renovation; 422 S. Parke Street – Solar Panels; 800 Hickory Drive – Alteration; 949 Beards Hill Road – Alteration; 320 S. Law Street – Deck; 949 Beards Hill Road – Roof Alteration;

The Preserve at Gilbert Meadows:

176 Total Lots

Total # of Permits Applied for – 168.

Total # of permits released: 168 (83 SFD/85 TH)

Total # of Type I Certificates of Occupancy released - 17.

Total # of Type II Certificates of Occupancy released - 144.

Aberdeen Overlook

344 Total Lots

Total # of Permits Applied for – 266.

Total # of permits released: 260 (84 SFD/176 TH)

Total # of Type I Certificates of Occupancy released – 13.

Total # of Type II Certificates of Occupancy released – 224.

C. Department of Public Works (DPW)

1. City Engineering & Administration

Code Compliance

Gilbert Meadows

- ESC inspection. In compliance. Home and townhome building continue in phase E. Sediment controls weekly inspections. Builder pre-start inspections for lot 0. Water vault inspections for lot 0. Use and Occupancy inspections for lot 0.

Aberdeen Overlook

- ESC inspection. Corrections needed. Home and townhome construction continues in phases 2, 4 & 5. The community center construction is completed. Pre-start inspection for lots 25 and 296-303. U&O Inspection for lots 58, 63, and 283-287. WM inspections for lot 62. Sediment controls weekly inspections. Builder pre-start inspections. Water vault inspections. Use and Occupancy inspections.

Fields of Aberdeen

- ESC inspection. Corrections needed. Completed report. Lots 2-12, 14 - 28, 72 - 94, & 30-60 are complete. Lots 62-70 are under construction. Sediment controls weekly inspections.

Wash X

- ESC inspection. In compliance. Building construction continues. Surface paving started on site.

MISC

- 500 Market Street – In compliance. The site is inactive.

FY2026 Curb, Sidewalk, and Street resurfacing 24-01:

- FY26 HUF – Resuming resurfacing projects on Dorsey St, Greene Ave, and Norman Ave. Goettner to return late July to complete FY26 work.

FY2027 Curb, Sidewalk, and Street resurfacing 27-01:

- FY27 HUF – Preparing list of roads, sidewalk connectivity, and concrete work. After Goettner completes remaining FY26 work, they will begin FY27 proposed work.

City Compliance

- 9 facilities from FY24 failing due to HOA accountability (Windemere) pending legal action.
- 1 facility failing from FY25 (Windy Hill Business Park) pending contractor correction. Work continues.

Code Enforcement

- Calls – 10 – Emails - 21
- Courtesy Fliers posted -0.
- Active cases – 48: Followed up on 15 active cases.
- Closed Cases – 8
- Letters sent this week – 9.
- Active high grass cases – 11
- Closed high grass cases – 6.

- Active Sewer Cap Cases – 28 Letters sent – 0 Followed up on – 0 Closed Cases – 0
- Active Smoke Testing cases – 3 Cases closed - 1.
- Sink holes near sewer laterals – 6 Follow up - 0.
- Violations posted – 6
- Citations written – 0.
- 114 Philadelphia Blvd - BG&E cut & capped the gas service lateral. The demo permit was issued 2026-07-07. In progress.
- 217 Carol Ave - Reinspected property on 2026-07-31. Not completed. Homeowner is getting another dumpster. In progress.
- 783 W. Bel Air Ave (Days Inn) – upper concrete walkway collapsed. Code Compliance met with owner and Architect David Stoker and informed them to get a Structural Engineer to inspect the building. Six (6) rooms, three upstairs and three on the ground floor have been cordoned off. Structural Engineer report received. In progress.
- 700 Maxa Rd - Code Compliance sent out a final notice letter for tying into city sewer, one certified, one regular. Waiting for 3 estimates or a signed contract. Property owner has till 2026-08-31 to send in a signed contract or 3 estimates. Deadline extended until 2026-08-31. In progress.
- 679 Everist Dr - police requested code compliance to come to property for hoarding/livability concerns. Inspected property and the residents have been cleaning out the house. A new dumpster has been delivered and cleanup is continuing. In progress.
- Battle Ave property - the unsafe structure committee is requiring code compliance to proceed with obtaining a structural engineer for the property. Mr. Velenovsky (Project Manager) for Skarda & Associates conducted an inspection of the property. Structural engineer report received on 2026-04-29. Structural engineer report was sent to the property owner on 2026-05-06. Structural Committee has asked for three (3) estimates for demolition. The Mayor asked for an updated report to confirm all steps were taken before approval to demo. The Director of Public works confirmed that all steps have been taken in following the city code 2026-07-15. In progress.

GIS

Analysis & Documentation

- **GIS vs. Billing Discrepancy Reporting:** Authored a comprehensive document investigating the data discrepancies between the GIS database and Billing System accounts to support data reconciliation and system alignment.

Data Creation & Technical Support

- **Hazard & Environmental Mapping:** Developed several critical shapefiles to identify roadways vulnerable to floodplains, environmentally constrained areas, and other hazard-prone zones.
- **Utility Data RFI Support:** Formatted and packaged utility data to assist with the Request for Information (RFI) report for HR Green.

Professional Development

- **Esri User Conference:** Attended several technical sessions focused on the integration of **AI in GIS**, exploring new workflows and automation strategies to improve organizational efficiency.

DPW Administrative Assistant

Facebook/Instagram

- Posted Aberdeen 250 5k Flyer.
- Posted Aberdeen Family Fun Day Flyer
- Posted upcoming 2026 Events.
- Posted for Region 7 Hydrant Flushing
- META Data Analysis (June 22 – July 19, 2026):
 - **Views = 92.5k** (The number of times your content was played or displayed. Content includes videos, posts, stories, and ads.)
 - **Follows = 71** (The number of times accounts followed you.)
 - **Visits = 3.8k** (The number of times your Page or profile was visited.)
 - **Interactions = 742** (The number of likes or reactions, saves, comments, shares and replies on your content, including ads. Content can include formats such as posts, stories, reels and more.)

Canva

- Designed new logo for our notification alert system for the website home page.
- Designed page banner for the top of the “Departments” page on the website.
- Fixed the Aberdeen 250 5K Flyer from Vicki H (had incorrect year).

New Website

- Worked on resizing of “Departments” page banner to conclude that Scale and 2:1 is the best size combination.

Utility Permits

- Permit 26-44 issued to Comcast for 721 Falcon Dr
- Permit 26-45 issued to Comcast for 895 Oxford Ave
- Permit 26-46 issued to Comcast for 718 Northern Lights

Click-2-Fix

- Reassigned pothole on 132 to MDOT system.
- Sent request from Eric to Maryann for Swan Meadows Dr/Victory Dr drain sunk issue.
- Sent request to Maryann for 5 N Rogers – chipper.
- Sent request to Maryann for 705 Paul Dr – chipper.
- Fwd. email to Maryann for Brian Peters’s chipper request

Finance

- Processed 14 invoices for payment totaling \$137,379.67.
- Submitted 8 requisitions totaling \$891,026.05.

Misc.

- Ordered new iPhone for Richard Singletong and Otter box case.
- Ordered replacement Android phone for the WWTP on call.
- Copied all June trash toter receipts.
- Reconciled June MES billing.
- Updated historical data .xlsx for MES recycle and trash collection.
- Compiled/submitted DPW WAR report for w.e. 07.10.26.

2. Maintenance Division

Buildings and Grounds

- Responded to 6 service requests.
- Provided chipper service for 110 residents.
- Cleanup of the tree damage from the storm is ongoing.

Streets and Stormwater

- Performed maintenance to 1 storm water swale.
- Checked 2 storm water inlets removed approximately 35 LBS of debris.
- Repaired storm water drain box near 771 Custis St.
- Fabricated a concrete storm drain lid for a storm drain box near Bears Hill and Shirley Dr.
- Fabricated a concrete storm drain lid for a storm drain box near Swan St. and Victory St.
- Replaced 4 temporary roadway patches with 9 tons of asphalt.
- Repaired 9 potholes.

Water and Sewer

- Responded to 6 requests for service.
- Performed 3 lead service line inspections.
- Performed water service shut offs to 102 delinquent accounts.
- Performed water shut down on Shirley Dr. for DXI utility work.
- Installed 2 residential water meters.
- Flushed 12 fire hydrants in region 7.
- Cleaned 1,390 LF and CCTV inspected 1,020 LF of sewer main.
- Performed investigative survey of the sewer main on Bonnett St.
- Repaired a section of 6" sewer main at 446 Bonnet St.
- Repaired a section of 8" sewer main using an internal repair patch at Clover St. and Angus St.

Fleet

- Scheduled Repairs: 9
- Emergency: 14
- Services: APD: 2
- Unit 34 – Sewer Vactor truck – Sent to dealer for emissions related failure.
- Unit 118 – Sent to Plaza for warranty work.
- Unit 101 – Trash Truck – Out of Service with PTO issue.

Department Staffing

- 4 openings in Maintenance.

3. Water/Wastewater Plant Operations

Wastewater Treatment Plant

- COA WWTP treated 13.2 million gallons. July. 8th to July. 14th.
- APG WWTP treated 2.4 million gallons. July 8th to July. 14th.
- Rerouted primary building sump pump discharge for PC#2 project.
- Overhead door repaired bad stop switch on main pump door.

Water Treatment Plant

- COA WTP treated 4.5 million gallons. July. 8th to July. 14th.
- APG WTP treated 6.3 million gallons. July. 8th to July. 14th.
- 10 routine bacteriological samples.
- Monthly well-head sampling.
- Inorganic organic compound sampling.
- Well 4 VFD tripped on overcurrent reset.

Department Staffing

- Six operator vacancies. One facility worker vacancy.
- Three after hour service calls.

Superintendents

- 20 APG contract hours.
- Submitted PepsiCo monthly sample report and invoice.
- Started gathering quotes for W/WW FY27 capital project.

D. Human Resources Department

Current Posted Openings – 16 total


- APG Maintenance Shop – 1 -Foreman, 1 Maintenance Worker
- DPW Maintenance Shop – 3 - Maintenance Workers
- W/WW – 6 Operators
- APD Sworn – 4 Officers
- APD Non – Sworn – 1 Crossing Guard – On Call

-Facility Worker starts on 7/20/2026

Payroll			
<u>Period Ending 7/11/2026</u>	<u># of Hours</u>		<u>Payroll Amt</u>
Regular	10,124.50		\$404,999.99
Sick	341.25		\$9,677.02
Vacation	869.73		\$19,419.12
Overtime	467.75		\$22,105.54
On Call O/T	167.00		\$8,365.57
Comp Time	117.00		\$3,449.32
Call-In Overtime	86.25		\$3,481.77
Personal	150.00		\$4,291.68
Court On-Call Overtime	124.00		\$6,766.80
Patrol Holiday	87.50		\$3,988.91
Holiday	1,097.00		\$27,946.33
Shift Differential			\$2,118.39
Adjustment			
Vacation Pay Out (1)			
Bereavement			
TOTAL PAYROLL	13,631.98		\$516,610.44

II. Aberdeen Police Department (APD)

A. APD Calls for Service

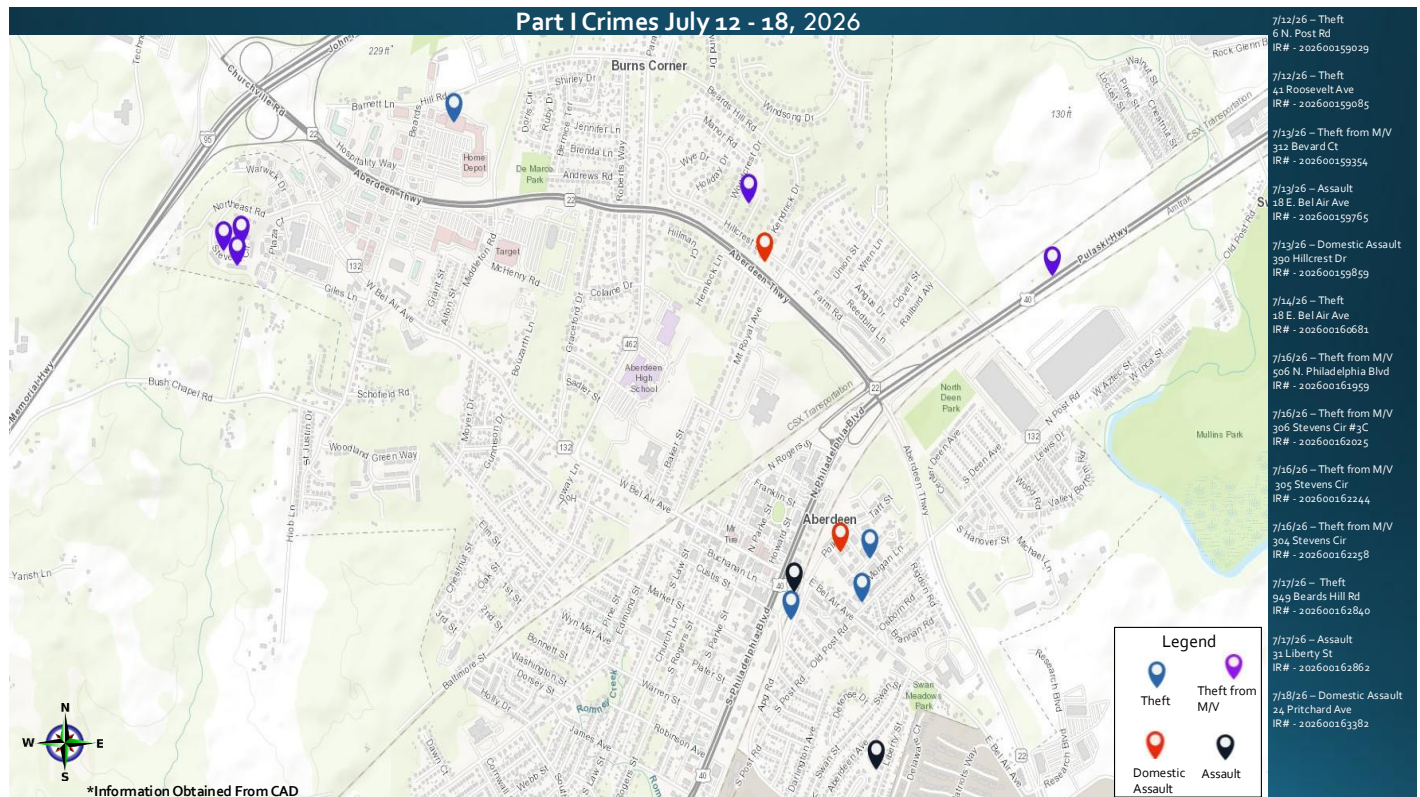

APD Calls for Service

July 12 - 18, 2026

Total Call for Service/Events Works - 538

Patrol Checks – 98

Community Policing Detail – 1

Foot Patrols – 77

Eastern District Incidents

- Missing Person – 1
- Theft – 3
- Assault – 3
- Narcotics – 1
- Protective Order Violation – 1
- Assist Other Agency – 1
- Vandalism – 1

Central District Incidents

- Fugitive – 1
- Child Neglect – 1
- Theft – 1
- Vandalism – 1
- Assist Other Agency – 1

Western District Incidents

- Theft – 5
- Assault – 1
- Child Neglect – 1
- DUI – 1
- Vandalism - 1

Arrest July 5 - 11, 2026**Adult Arrest**

202600155045	7/7/26	Theft
202600155328	7/7/26	Disorderly
202500234439	7/7/26	Fondling
202600155757	7/8/26	Warrant
202500034188	7/8/26	Warrant
202600157226	7/10/26	Warrant
202600157886	7/11/26	Trespassing
202600158232	7/11/26	Trespassing
202600158232	7/11/26	Trespassing

Juvenile Arrest

202600153647	7/5/26	Warrant
202600157534	7/11/26	Assault

B. Weekly Traffic Report

July 12 - 18, 2026

Traffic Stops

119 Stops/Contacts

63 State Citations

147 Warnings

2 Safety Equipment Repair Orders

2 DUI

Crashes (Reportable, PI/PD)

2 (1 Property Damage, 1 Personal Injury)

SMART (Speed Monitoring Awareness Radar Trailer)

- Aberdeen Thruway E / Mount Royal Ave
- Aberdeen Thruway W / Mount Royal Ave

STATTRAK

- N/A

C. IT

- 29 Miscellaneous user/computer issues
- Daily surveillance camera check
- Daily firewall inspection and report
- Weekly PMI backup checks
- APD report co-created with Sr. Admin specialist for the Chief.
- 255 LPR install.
- CALEA proof x1
- Attend CJIS audit.
- Attend survey meeting with command staff.
- IT meeting with municipality technology staff

D. Accreditations

Proofs of Compliance

Processed and filed in PowerDMS.

Department of Emergency Services

Studied, located, and filed DES policies in Communications standards folders.

Plans for Future Weeks

Proofs of CALEA Compliance

Training Course Plan – Write Roll Call Training for Accreditation, Consular Notification.

Policies

Ch 05.03 Internal Affairs & Internal Investigations – Finish updating.

Ch 25.03 Citation Control – Update disposition, storage, and retention.

Ch 28.06 Juvenile Offenders – Finish updating Custodial Interviews.

Ch 14.02 Line Inspections – Reorganize and amend for consistency.

E. Administration

Administrative Corporal

Fleet

Units 217, 222, 231 & 223, 219 all need new decals due to fading. The form 98 has been submitted.

Requested graphics and quotes for decals on the side by side. I went to DPW and took photos of the faded images.

Unit 237 – Unmarked gray impala was repaired and picked up.

Unit 203 – still has issues starting.

Emailed 2x in reference to needing the quote on Unit 244. Supervisors have been advised.

Unit 235 – Installed front and rear brakes.

Unit 227 – repairs completed.

Vehicle numbered plates 098 form were submitted. Quote \$1105.64

Unit 211 – Submitted form 98 for AC repair at Al Packer.

Vehicles were moved from DPW to WWTP. 3 of these are pool units.

Unit 204 – PM completed.

Ofc. Johnson located his EZPass.

Requested quote from Image 360 for plates for each vehicle.

Notified officers that pool vehicles 201, 227 and 235 are all complete at DPW and can be utilized. I will move them back to the WWTP tomorrow.

Unit 244 – needs estimate due to 95 damaging rear door. This is pending Off. Wangu.

The transponder was replaced in 243 and moved to the proper location.

Arrangements for All Roads to meet at DPW have been made in an effort to secure an estimate on Unit 232 that was involved in the crash. This is scheduled for 7/14/26 at 0730 (Alex). After meeting with Alex, Captain Reiber informed me that the vehicle is totaled. I emailed Mr. Hartsock . He stated that he is waiting for the evaluation from our insurance company.

Grants

MCIN Grant final report, along with a narrative about mentionable items, was prepared and submitted to Chief and MCIN Coordinator. The final invoice was also submitted. All funding was expended.

Gun Violence Reduction Grant – Received an award for \$12,500 and it would not fund the training we requested. They allowed us to do a budget medication. We requested 1 SWAT Shield and 12 other shields to ensure supervisors and schools have them on hand. I prepared the narrative and budget and resubmitted it via the portal. An email was also sent to this effect notify the funding source. We received the final award packet granting us \$12k. I signed the documentation and uploaded it into their portal for processing.

Community Policing / Relations

Mailed recycled APD patches to requestors.

Forwarded 2026 Christmas Street Parade OPS plan to Vickie Harter and our command staff.

National Night Out will be advertised on our social media platforms.

Provided Slurpee coupons to squads and bike patrol for community policing this month!

Prepared comprehensive, detailed report for Chief that involved our administration duties, community involvement and how we conduct performance measures. This took two days to complete.

Training

Created a roll call training in reference to driving unmarked patrol units. This is in response to the recent crash. This will be conducted by all squads and documented no later than July 17th.

Personnel

Conducted CVSA exam on Lateral applicants.
Responded to Vicki Harter in reference to the overtime 5K.
Participated in Oral Boards on Lateral Applicant.
Reviewed CVSA exam conducted by Det. Garrett.
Submitted form 098 for kitchen bulletin board for notices.
Conducted Foot Patrol with Rodney for communication purposes.

Miscellaneous

Approved, entered, scanned all vehicle invoices.
Oversaw PIO postings.
Submitted form for new calendar.
Final Community Report to be submitted to GOCCP.
Ordered more bike helmets per Captain Reiber. A/Cpl. Haddix was notified. Forms printed for our records of receipt.
Assisted with 10-95's and female searches.
Transported stolen lawn mower from East Side (Green Avenue) back to station.
Processed car wash invoices and holding 2 invoices for NAPA. There appears to be double charging for one vehicle. Pending a response.
Trained Ofc. Potts on Skills Manager so that she could provide assistance with entering data while she is on light duty.

Community Safety Specialist Rodney Thomas #554

07/13 Monday:

- Arrived at Festival Park to conduct a foot patrol of the area.
- Arrived at the Train Station, which was in good condition, conducted a walkthrough of the Train Station.
- Auto doors locked, cleared, and secured the Train Station.
- Patrolled the Train Station and parking areas.
- Police Station until the end of my shift.

07/14 Tuesday:

- Arrived at Festival Park to conduct a foot patrol of the area.
- Arrived at W. Bel Air Ave for foot patrol.
- Arrived at Beards Hill Shopping Center for a foot patrol.
- Arrived at the Train Station, which was secure and in good condition, conducted a walkthrough of the Train Station.
- Patrolled the Train Station and parking areas.
- Cleared and secured the Train Station after the cleaning crew had departed.
- Patrolled the Train Station and parking areas.
- Arrived at the Police Department until the end of my shift.

07/15 Wednesday:

- Arrived at Festival Park to conduct a foot patrol of the area.
- Arrived at the WAWA for foot patrol.
- Arrived at the Train Station, which was secure and in good condition, conducted a walkthrough of the Train Station.
- Patrolled the Train Station and parking areas.
- Cleared and secured the Train Station after the cleaning crew had departed.
- Patrolled the Train Station and parking areas.

- Arrived at the Police Department until the end of my shift.

07/16 Thursday:

- Arrived at Festival Park to conduct a foot patrol of the area.
- Arrived at DPW to move vehicles to the Wastewater Treatment Plant.
- Arrived at the Train Station, which was secure and in good condition, conducted a walkthrough of the Train Station.
- Patrolled the Train Station and parking areas.
- Cleared and secured the Train Station after the cleaning crew had departed.
- Patrolled the Train Station and parking areas.
- Arrived at the Police Department until the end of my shift.

07/17 Friday:

- Arrived at Festival Park to conduct a foot patrol of the area.
- Arrived at West Bel Air Ave for foot patrol.
- Arrived at the WAWA for foot patrol.
- Arrived at the Train Station, which was secure and in good condition, conducted a walkthrough of the Train Station.
- Patrolled the Train Station and parking areas.
- Cleared and secured the Train Station after the cleaning crew had departed.
- Patrolled the Train Station and parking areas.
- Arrived at the Police Department until the end of my shift.

F. 24 Hour Reports

Date of Incident: 06/30/2026

Incident Type: Stolen Vehicle

Incident Report Number: 202600148133

Location of Incident: [REDACTED]

Reporting Officer: A/Cpl. Kinlaw

Update:

On 7/14/26, A/Cpl. Kinlaw was informed that Deputy Bergers S906 from the Harford County Sheriff's Department had found the [REDACTED] that had been stolen out of Aberdeen. A/Cpl. Kinlaw was advised that driver side window was broken, the steering column was damaged, and door handle was destroyed. The vehicle was towed by Cullums Towing to the Aberdeen Police department for processing.

Synopsis of Events:

On June 30th, 2026, Cpl. Kinlaw was dispatched to [REDACTED] for a reported Vehicle theft report. Upon arrival he met the Victim [REDACTED]. The Victim advised this morning around 0530 hours he left his apartment and went to where his vehicle was parked and discovered it had been stolen. He found the door handle lying on the ground where the vehicle had been parked. He picked it up and called the Police. The vehicle stolen was a [REDACTED] bearing [REDACTED] registration [REDACTED] with VIN# [REDACTED]. The Victim advised he parked his vehicle last evening at 1800 hours and locked the doors and windows. He further advised there is only one key and he has it. The Vehicle was into the N. C. I. C. Stolen files by Aberdeen Police Department Records.

Date of Incident: 7/15/2026

Incident Type: Child Neglect

Incident Report Number: 2026-00161552

Location of Incident: [REDACTED]

Reporting Officer: OFC. S. Howard, ID# 181

Synopsis of Events:

On July 15, 2026, at approximately 1640 hours, Officer Howard responded to Walmart, located at 645 S. Philadelphia Boulevard, Aberdeen, for a report of child neglect.

An off-duty MDTA Police Captain reported that three young children, ages 4, 2, and 1, had been left unattended in a running, unlocked vehicle for approximately 40 minutes while their mother, [REDACTED], shopped inside. [REDACTED] admitted she left the children because they were asleep.

CPS was contacted and approved releasing the children to their father, who responded to the scene.

[REDACTED] was subsequently arrested and charged with child neglect.

Date of Incident: 07/17/2026

Incident Type: Domestic Assault/ 1st Degree Assault

Incident Report Number: 202600162862

Location of Incident: [REDACTED]

Reporting Officer: A\Cpl. Kinlaw

Synopsis of Events:

On 7/17/26, Officers were dispatched to [REDACTED] in regards to a physical domestic.

Officers made contact with [REDACTED] who advised that her boyfriend, [REDACTED] punched her in the mouth. Following this, [REDACTED] attempted to leave the vehicle they were both in. During this time, [REDACTED] drove off while [REDACTED] leg was hanging out of the vehicle. [REDACTED] advised him to stop the vehicle and attempted to retrieve her keys when [REDACTED] pinned her to the vehicle. [REDACTED] subsequently pepper-sprayed him. [REDACTED] then pulled a knife and threatened to "gut her like a fish." Two witnesses were present with corroborating statements.

[REDACTED] fled the scene prior to Officers arrival. The vehicle was later found in [REDACTED] unoccupied.

Investigation is ongoing

Date of Incident: 7/18/2026

Incident Type: Attempted MV Theft

Incident Report Number: 2026000163386

Location of Incident: [REDACTED]

Reporting Officer: Det. Douglas A151

Synopsis of Events:

On 7-18-26 officers responded to [REDACTED] regarding an attempted motor vehicle theft. Upon arrival, contact was made with the victim [REDACTED], who explained someone tried to steal his [REDACTED]. [REDACTED] had been alerted by his vehicle's audible alarm. Officers observed the vehicle's steering wheel column cover and part of the driver's exterior door handle lock lying on the ground next to the vehicle, while the door handle was missing completely. Inside appeared to have been rummaged through for items, however, nothing was taken.

Investigation is ongoing

Date of Incident: 7/20/2026

Incident Type: MV Theft

Incident Report Number: 2026-00164688

Location of Incident: [REDACTED]

Reporting Officer: Det. Douglas 151

Synopsis of Events:

On July 20th, 2026, at approximately 2354 hours, Officer responded to [REDACTED] [REDACTED] in reference to a hit and run. While enroute, Officers learned that the caller's vehicle was stolen and crashed into two of their other vehicles while fleeing from the residence. Officers spoke to [REDACTED], who advised he was alerted to the situation when he heard the sound of the crash in front of his house. The stolen vehicle was a [REDACTED] [REDACTED]. The vehicle was entered into NCIC as stolen.

G. Media Release

Mother Arrested in Child Neglect Investigation, Second Incident

On July 16, 2026, at approximately 11:32 a.m., Aberdeen Police responded to an apartment in the unit block of Northeast Road after receiving a report of two young children left unattended inside an apartment.

Officers located two girls, ages 3 and 5, alone inside the apartment and observed unsafe and unsanitary living conditions. The children appeared lethargic and were transported to the hospital for evaluation.

The children's mother, 23-year-old Kahliyah Gooding, was located at her place of employment, arrested, and charged after allegedly admitting she had been leaving the children home alone while she worked because she could not afford daycare.

This arrest follows a similar child neglect investigation involving Ms. Gooding on May 6, 2026, at which time she was also charged.

Child Protective Services assumed custody of the children. The investigation remains ongoing.

The Aberdeen Police Department reminds parents and caregivers that leaving young children unattended in a vehicle, even for a short period, can place them at significant risk and may result in criminal charges.