


NOT TO SCALE

**NOTES:**

1. METER VAULTS SHALL NOT BE LOCATED IN DRIVEWAYS, SIDEWALKS OR STEPS. DRIVEWAYS SHALL BE TAPERED AS REQUIRED.
2. METER VAULTS MUST BE ONE (1) FOOT FROM PROPERTY LINE AND ONE (1) FOOT FROM PAVED SURFACES. (SEE DETAIL)
3. METERS TO BE SUPPLIED WITH INDIVIDUAL SERVICE LINES WITH SEPARATE ENCLOSURES. TWIN CONNECTIONS AND SHARED SERVICES NOT PERMITTED IN CITY OF ABERDEEN.
4. ALL CLEANOUTS SHALL USE TRAFFIC BEARING FRAME & COVER PER STD DETAIL S-28.
5. MINIMUM SEPARATION BETWEEN WATER AND SEWER SERVICES IS SEVEN (7) FEET.

**DETAIL**

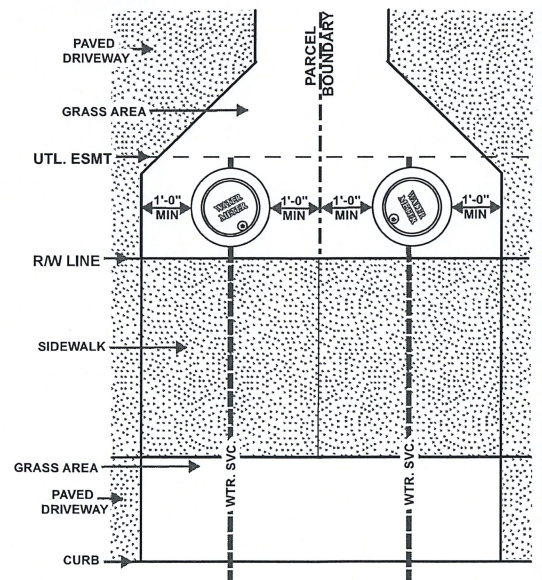

CITY OF ABERDEEN  
DEPARTMENT OF PUBLIC WORKS

*Kyle Jorsts*

**STANDARD WATER DETAILS**

**WATER AND SEWER SERVICES  
FOR TOWNHOUSE LOTS WITH  
7' OR LESS BETWEEN DRIVEWAYS**

**CITY OF ABERDEEN  
ADDENDUM TO  
HARFORD COUNTY  
STANDARD DETAILS**

PLATE **G-3a**