

CITY OF ABERDEEN
DEPARTMENT OF PUBLIC WORKS

Kyle Jouts

STANDARD SERVICE CONNECTION
WITH METER PIT



STANDARD WATER DETAILS

PLATE W-17

CITY OF ABERDEEN
ADDENDUM TO
HARFORD COUNTY
STANDARD DETAILS

- NOTES:**
1. MINIMUM PIPE SIZES ARE SPECIFIED
 2. ALL BRASS FITTINGS TO BE COMPRESSION TYPE ONLY
 3. DIRECT TAPPING OF MAINS IS NOT PERMITTED, APPROVED TAPPING SADDLE AND CORP MUST BE USED
 4. METER PIT SHALL NOT BE PLACED IN DRIVEWAYS, STEPS, OR SIDEWALKS
 5. SERVICE LINE FROM MAIN TO METER PIT SHALL BE ONE CONTINUOUS PIECE (NO JOINTS)
 6. THE LIMIT OF CITY OF ABERDEEN RESPONSIBILITY IS THE METER VAULT

- WATER SERVICES FOR TOWNHOUSES AND SINGLE FAMILY LOTS**
- 1" COPPER TUBING FOR SINGLE HOUSE CONNECTIONS (TWIN HOUSE CONNECTIONS NOT PERMITTED)
 - 1" COPPER TUBING SHALL BE USED UNLESS OTHERWISE SPECIFIED BY FIRE PROTECTION REQUIREMENTS

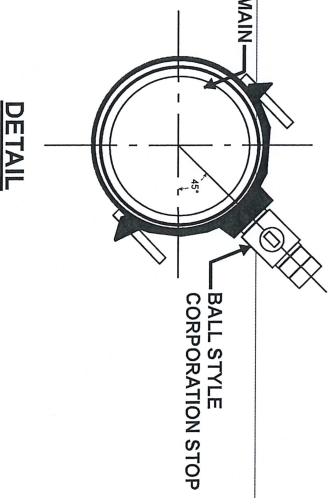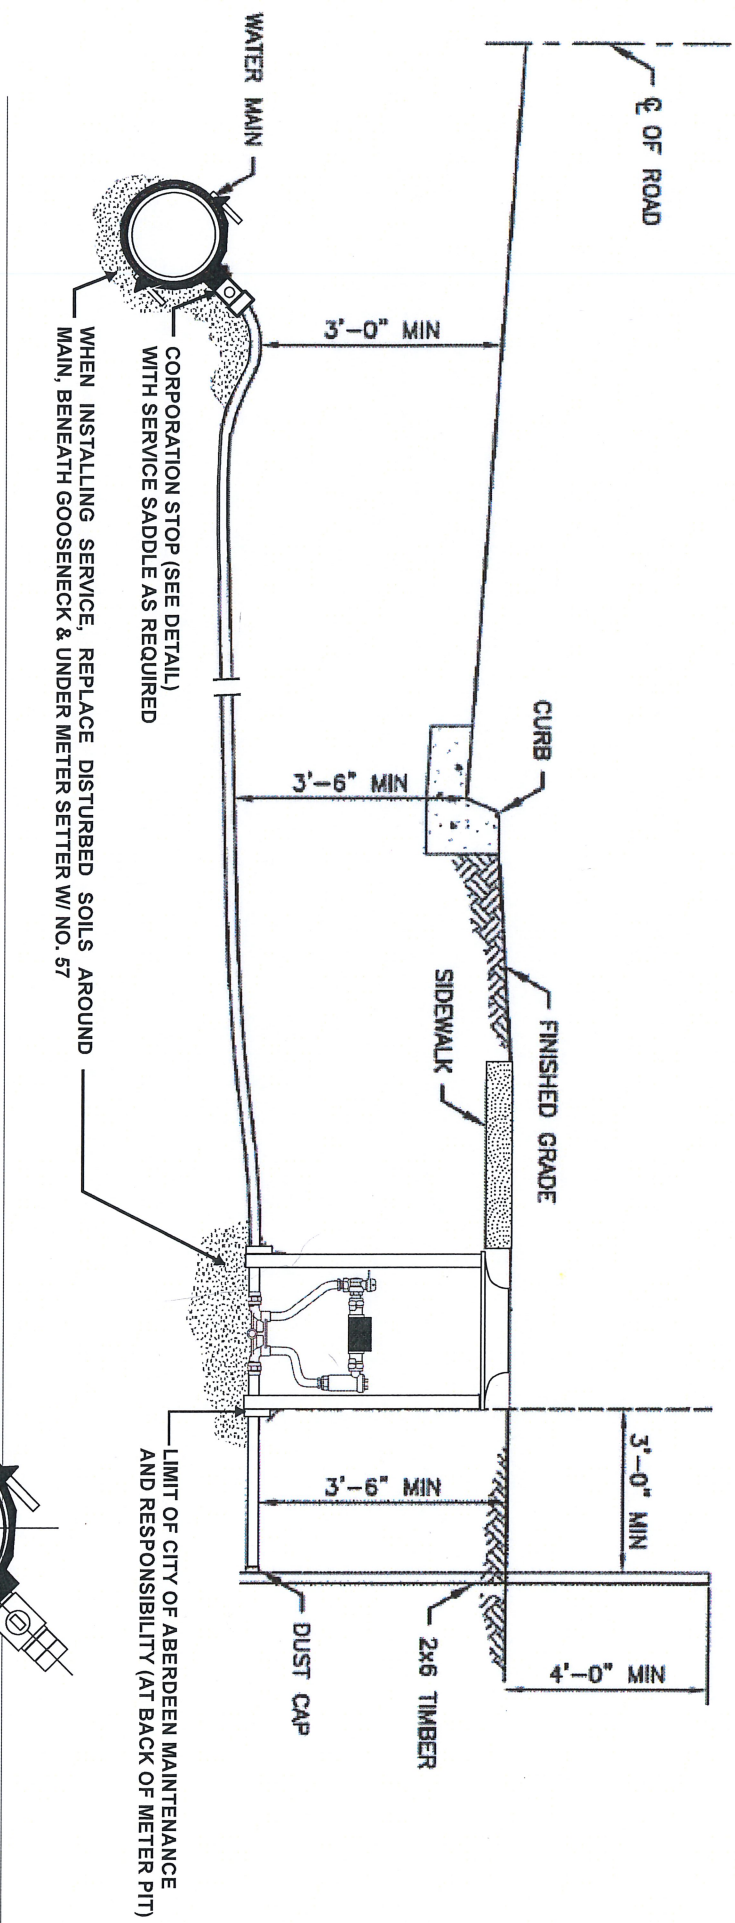

DETAIL