


PLAN

- NOTES:**
1. ALL FITTINGS TO BE COMPRESSION FITTINGS.
 2. SERVICE LINE FROM MAIN TO METER SHALL BE ONE CONTINUOUS PIECE (NO JOINTS).
 3. PROVIDE 3'-6" COVER OVER SERVICE LINE EXCEPT WHERE SHOWN OTHERWISE.
 4. METER PITS SHALL NOT BE LOCATED IN DRIVEWAYS, SIDEWALKS OR STEPS.
 5. THE LIMIT OF CITY OF ABERDEEN RESPONSIBILITY IS AT THE BACK OF THE METER PIT.
 6. SPRINKLER SYSTEM REQUIREMENTS DETERMINED BY FIRE PROTECTION PROFESSIONAL.

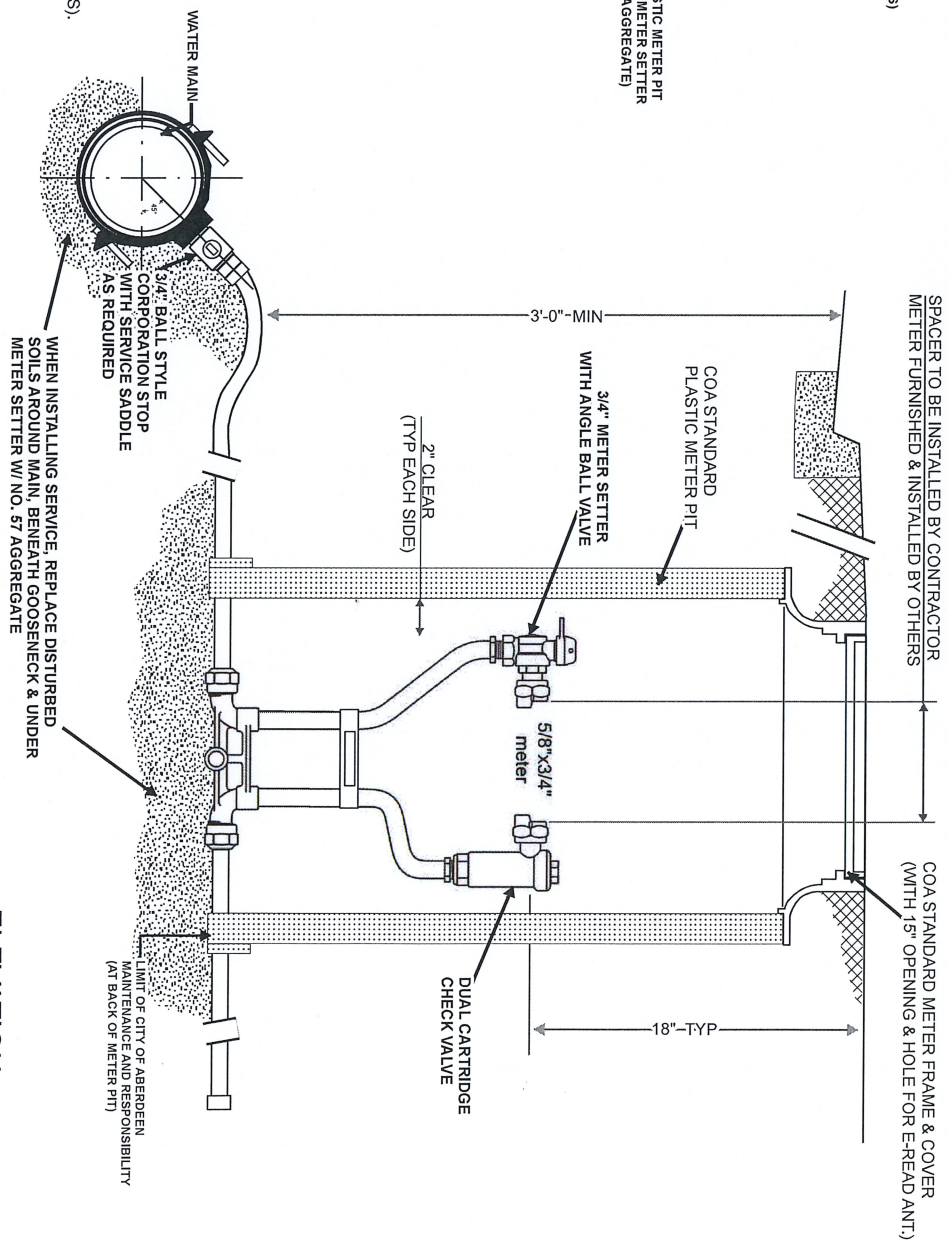

ELEVATION

STANDARD WATER DETAILS

OUTSIDE SETTING
3/4" SUPPLY WITH 5/8"x3/4" METER
(DOMESTIC SERVICE WITHOUT SPRINKLER SERVICE)



CITY OF ABERDEEN
DEPARTMENT OF PUBLIC WORKS

Ryle Jovels

CITY OF ABERDEEN
ADDENDUM TO
HARFORD COUNTY
STANDARD DETAILS
PLATE W-18